Drawing for information ONLY. Prior to any construction, a scaled mechanical drawing is to be submitted for approval to ACWWA. Drawing shall include; piping arrangements, meter and backflow location, drain location and size, dimensions above floor and from walls and other pertinent information.

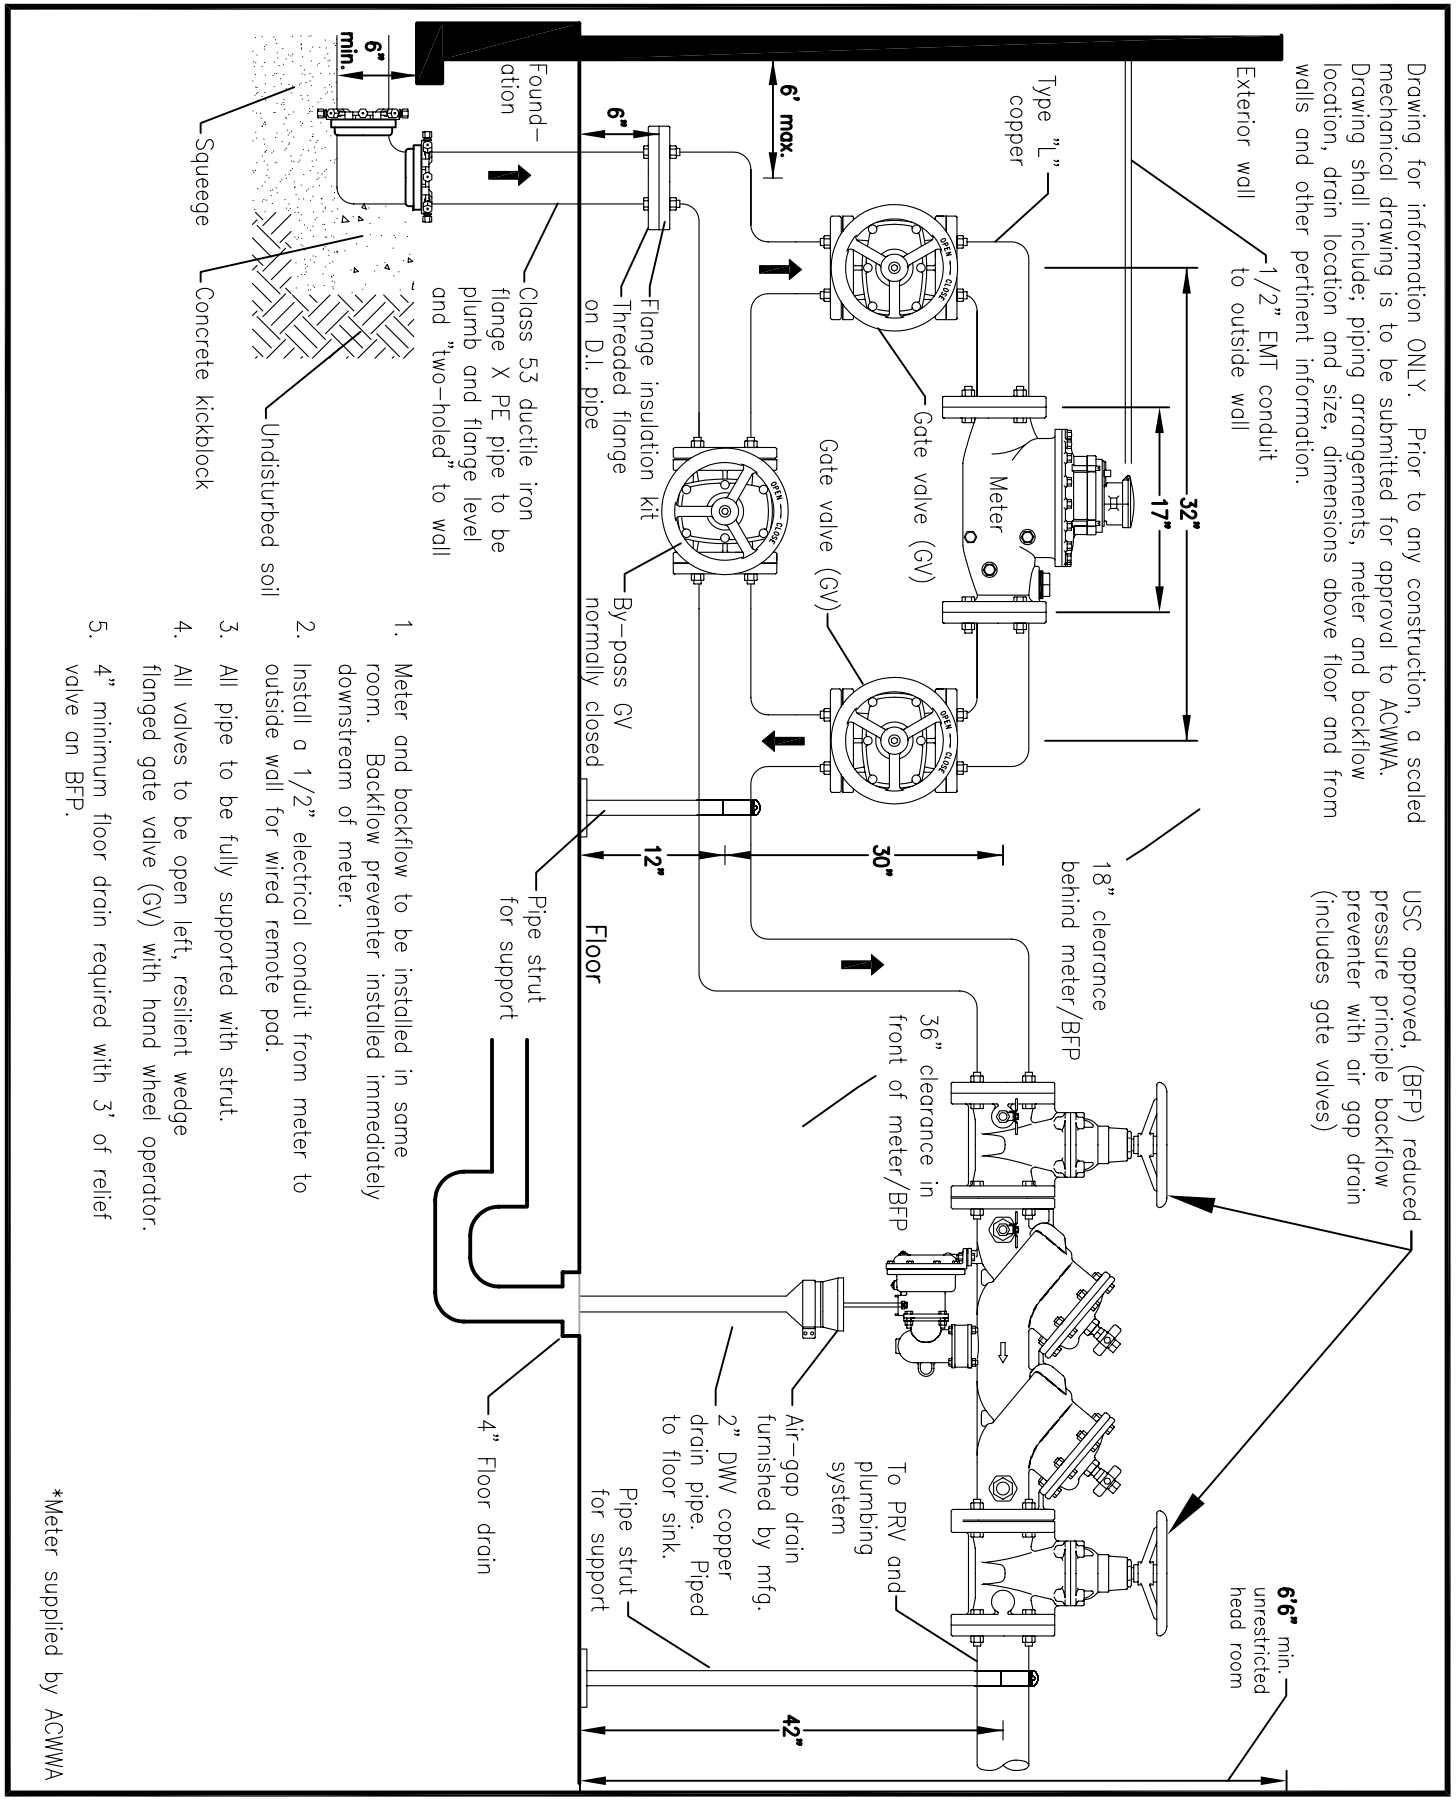

1. Meter and backflow to be installed in same room. Backflow preventer installed immediately downstream of meter.
2. Install a 1/2" electrical conduit from meter to outside wall for wired remote pad.
3. All pipe to be fully supported with strut.
4. All valves to be open left, resilient wedge flanged gate valve (GV) with hand wheel operator.
5. 4" minimum floor drain required with 3' of relief valve an BFP.

*Meter supplied by ACWWA

ARAPAHOE COUNTY
Water and Wastewater Authority
13031 E Caley Ave, Centennial, Colorado 80111
Ph: (303) 790-4830 Fax: (303) 790-1718
© Copyright 2007 All Rights Reserved

3" INSIDE METER SETTING

REVISION DATE: 9/7/2005
FIGURE NO. W-29
SHEET NO. 1 of 1