


**NOTE:**

1 - PLACEMENT OF STOP BOX CAN VARY FROM A MAXIMUM OF 5 FEET OUTSIDE THE PROPERTY LINE TO THE PROPERTY LINE. PLACEMENT OF THE STOP BOX OUTSIDE THE PROPERTY LINE IS PREFERRED.

2 - OWNER'S RESPONSIBILITY FOR LEAK REPAIR SHALL BE UP TO AND INCLUDING THE TUBE NUT WHICH THREADS ONTO THE CURB STOP.

3 - ACWWA WILL REPAIR LEAKS ON SERVICE LINES WHEN NOTIFIED, FROM THE CORPORATION STOP TO CURB STOP.

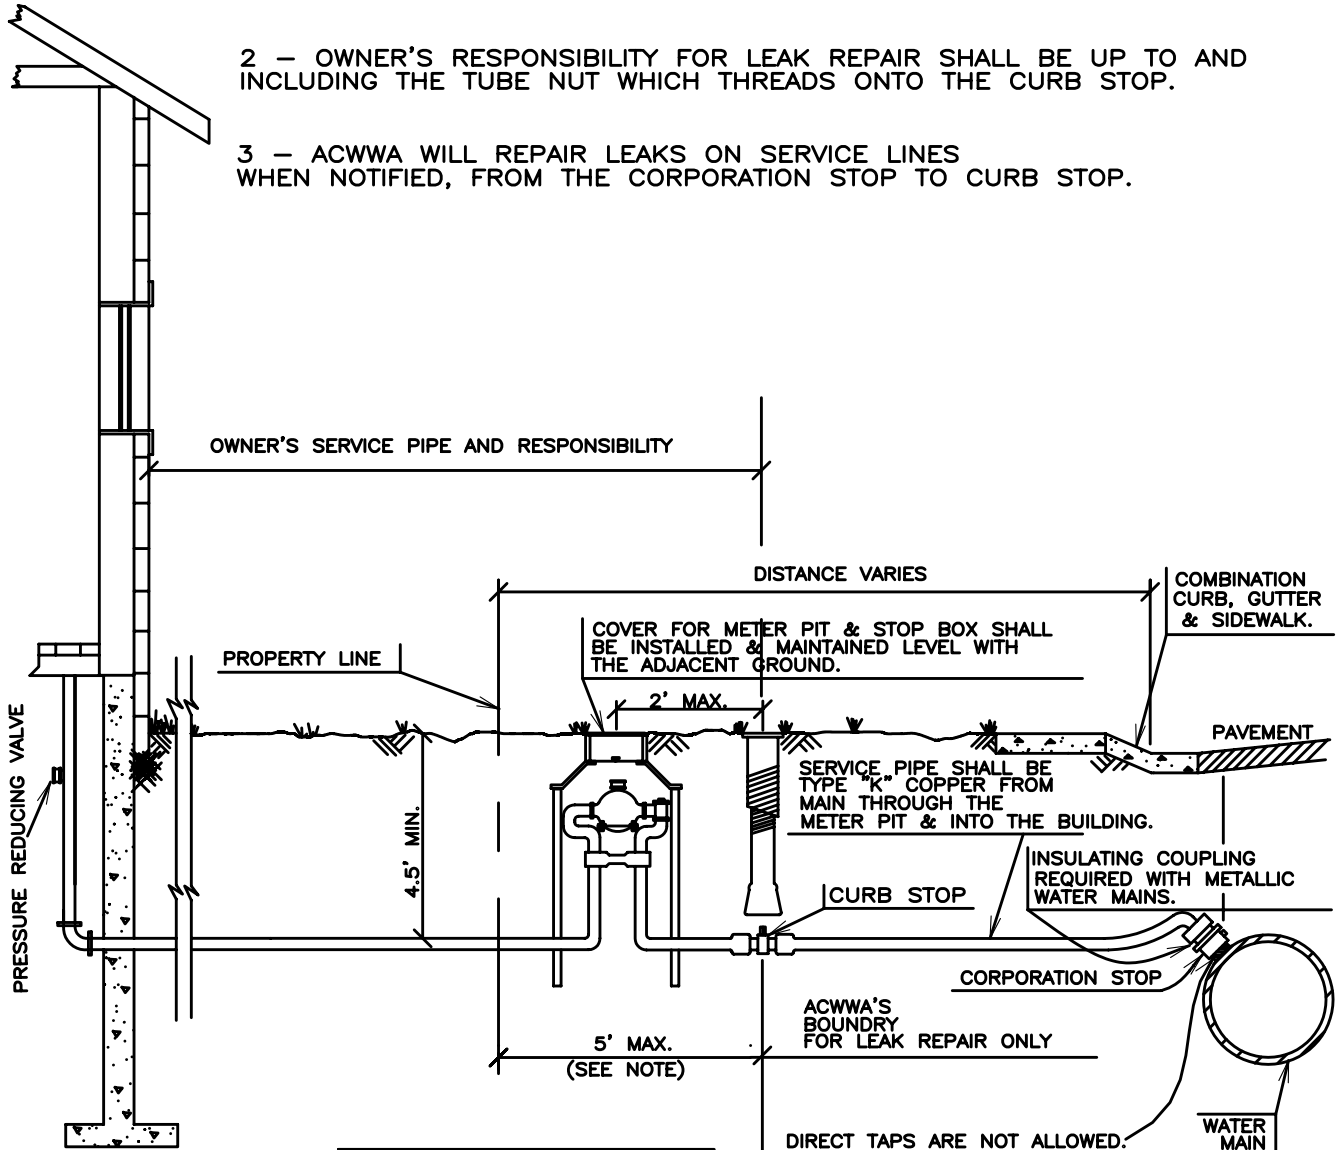

SHOULD ANY SITUATION ARISE OTHER THAN SHOWN CONCERNING THE DEPTH OR OBSTRUCTION OF SERVICE LINE OR THE PLACEMENT OF METER PIT OR STOP BOX CALL 303-790-4830 AND ASK FOR CUSTOMER SERVICES FIELD SECTION.

DIRECT TAPS ARE NOT ALLOWED. WIDE BAND SINGLE STRAP TAPPING SADDLES ARE REQUIRED FOR PVC PIPE. DUCTILE IRON/STEEL PIPE SHALL BE DOUBLE STRAP BRASS SADDLE.

**ARAPAHOE COUNTY**  
 Water and Wastewater Authority  
 13031 E Caley Ave, Centennial, Colorado 80111  
 Ph: (303) 790-4830 Fax: (303) 790-1718  
 © Copyright 2007 All Rights Reserved

**DOMESTIC SERVICE LINE;  
 STOP BOX & OUTSIDE METER  
 INSTALLATION**

REVISION DATE:  
 9/7/2005  
 FIGURE NO.  
**W-3**  
 SHEET NO.  
 1 of 1